

COMMONWEALTH OF KENTUCKY
BEFORE THE PUBLIC SERVICE COMMISSION

In the Matter of:

THE APPLICATION OF OAK HILL WATER)	
ASSOCIATION, INC. FOR A DEVIATION)	
PURSUANT TO 807 KAR 5:066, SECTION)	CASE NO. 91-400
5(4), REGARDING WATER STORAGE)	

O R D E R

On October 31, 1991, Oak Hill Water Association, Inc. ("Oak Hill") filed an application for a deviation from Commission Regulation 807 KAR 5:066, Section 5(4), which requires that each utility shall maintain water storage to ensure a minimum of one day's supply of its average daily water usage.

On February 10, 1992, Oak Hill filed a letter from its supplier, Somerset Water Service ("Somerset Water"), which indicated and assured that it would provide Oak Hill's needed storage for the next five years.

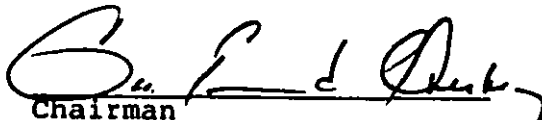
The Commission, having reviewed the application, the information submitted subsequent thereto, and being otherwise sufficiently advised, finds that:

1. Oak Hill has no water storage tanks in operation in its water distribution system.
2. Oak Hill's average daily water usage is approximately 129,032 gallons per day.
3. Somerset Water is willing to provide Oak Hill with needed storage capacity.

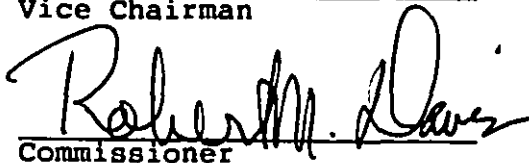
IT IS THEREFORE ORDERED that Oak Hill be and it hereby is granted a deviation from the water storage requirements of 807 KAR 5:066, Section 5(4), for so long as its agreement with Somerset Water remains in effect, but no later than January 1, 1997.

Done at Frankfort, Kentucky, this 6th day of March, 1992.

PUBLIC SERVICE COMMISSION


Chairman


Vice Chairman


Commissioner

ATTEST:


Executive Director